

## ELECTRICAL PACKAGE -- Job#3931358

NO.	TAG	PACKAGE #	LOCATION	SWITCHES		OPTION	FANS CONTROLLED			
				LOCATION	QUANTITY		TYPE	#	HP.	VOLTY FLA
1		SC-32110MA-SEP	Wall Utility Cabinet Left	08 - Ship Loose w/ Prewire	1 Light 1 Fan	Smart Controls Thermostatic Control w/ Relay On/Off with Supply	Exhaust	3	2,000	208 5.9
							Exhaust	3	2,000	208 5.9
							Supply	3	5,000	208 15.0

JOB NO  
3931358MODEL NUMBER  
SC-32110MA-SEP

DRAWN BY

SCHEMATIC TYPE  
INSTALL

## DESCRIPTION OF OPERATION:



3 Phase w/ control for 2 Exhaust Fans, 1 Supply Fan, Exhaust on in Fire, Lights out in Fire, Fan(s) On/Off Thermostatically Controlled. Separate Breaker Input for each Fan. Room temperature sensor shipped loose for field installation. INVERTER DUTY 3 PHASE MOTOR REQUIRED FOR USE WITH VFD.

JOB NAME  
Panda Express - Rome GA (58-2...DATE  
8/5/2019DWG NO  
ECP #1-1

## BREAKER PANEL TO PRIMARY CONTROL PANEL



Responsibility: Electrician

BREAKER SIZE SHOWN IS THE MAXIMUM ALLOWED

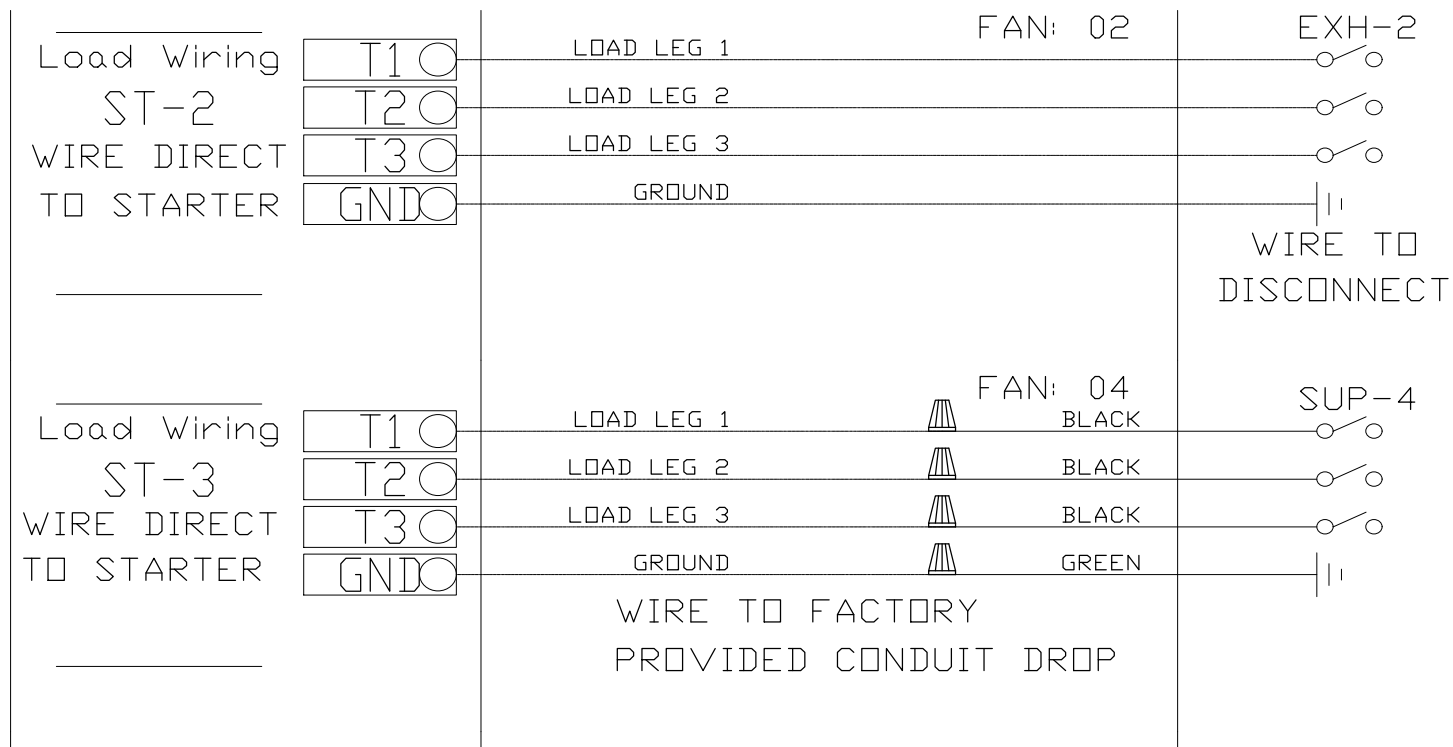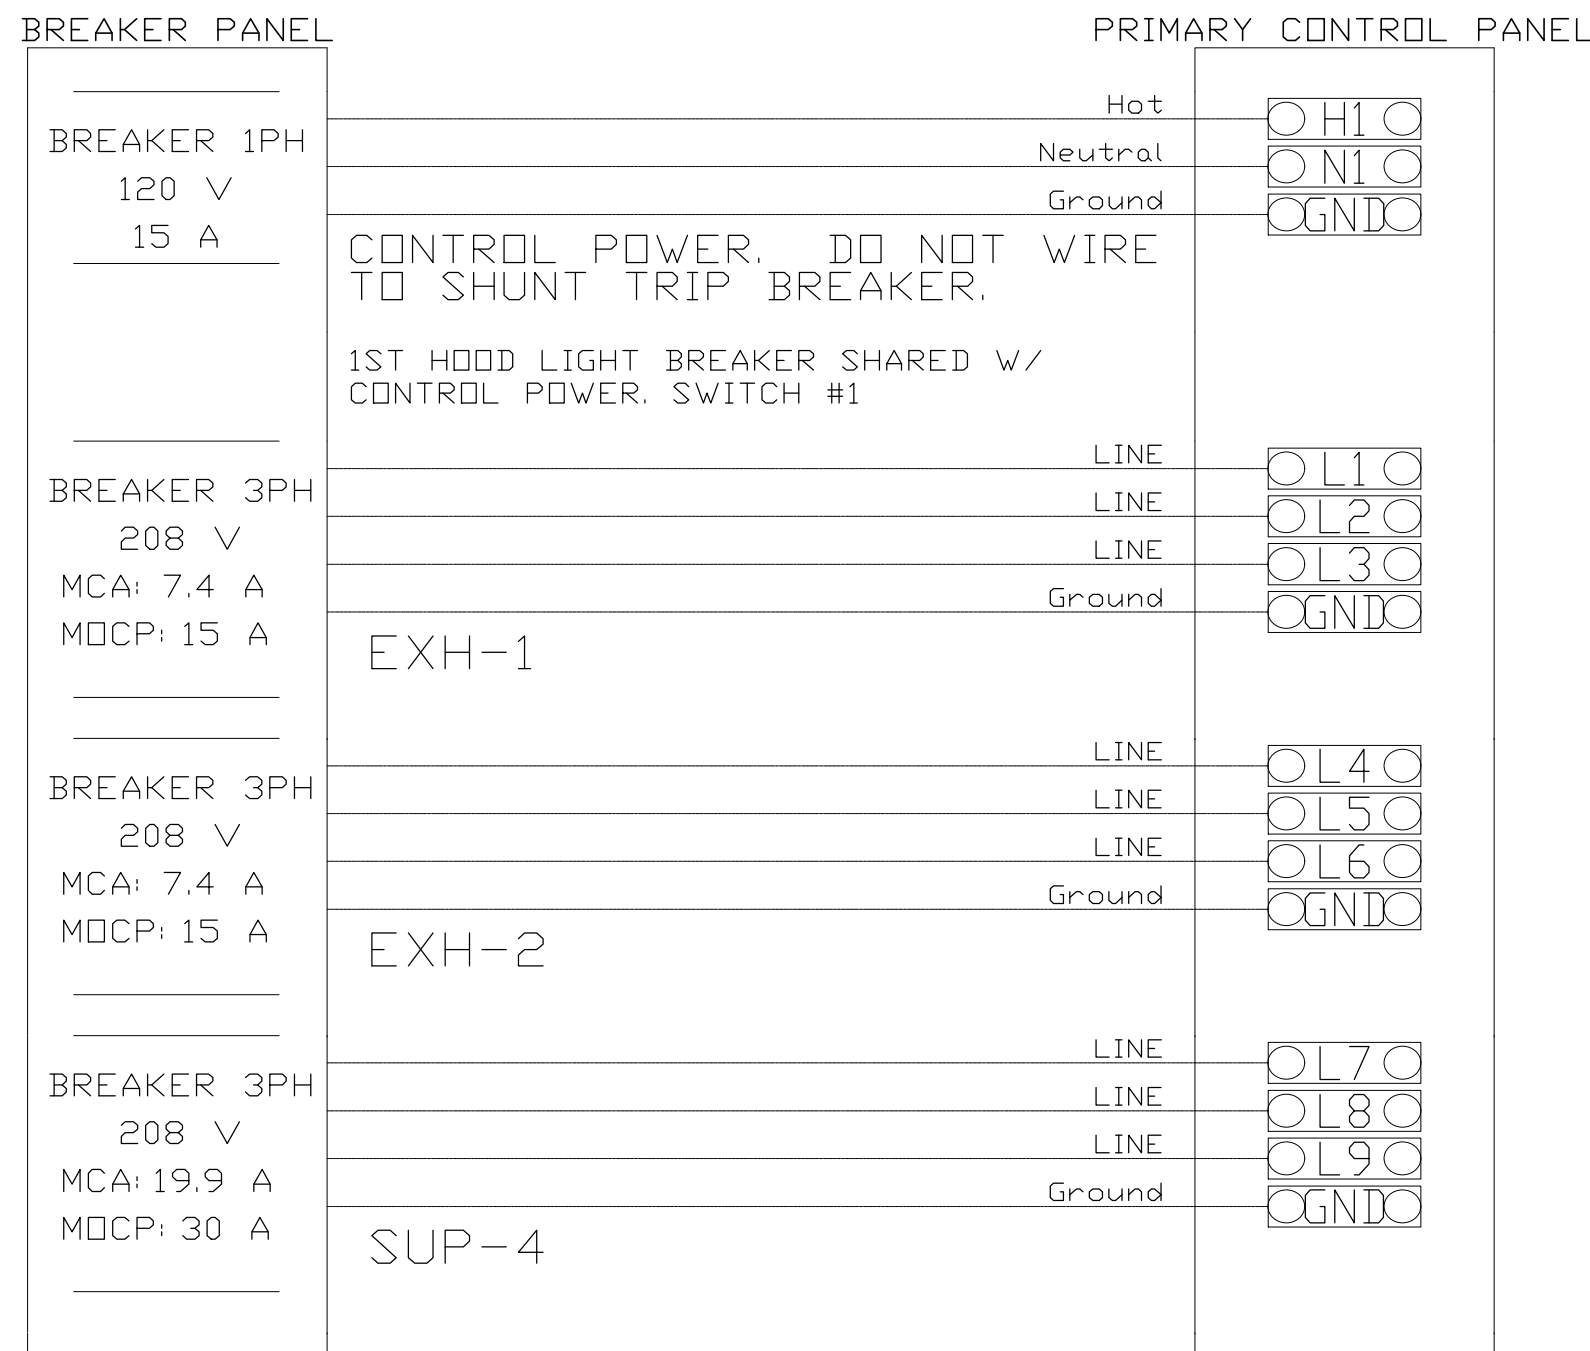


## CONTROL PANEL TO ACCESSORY ITEMS

Responsibility: Electrician

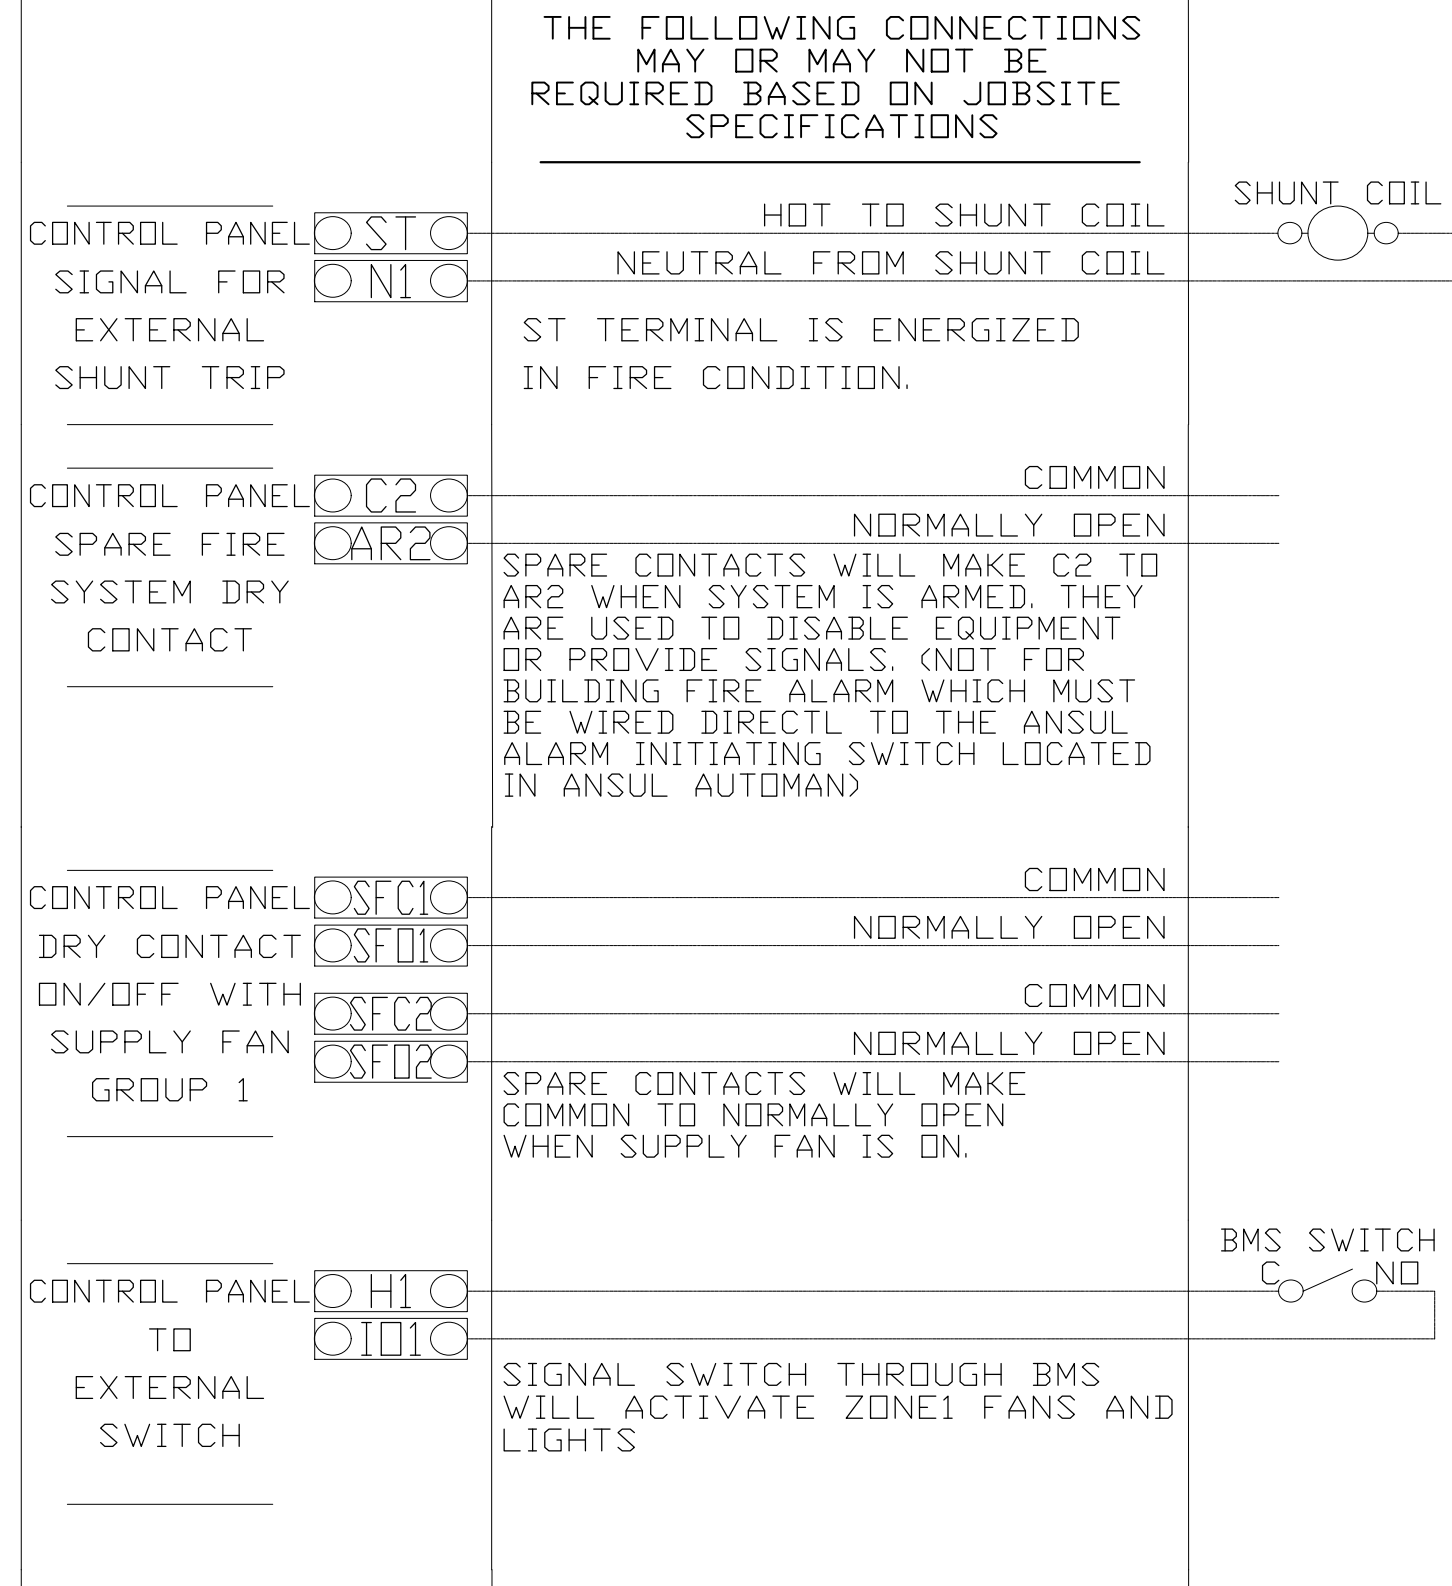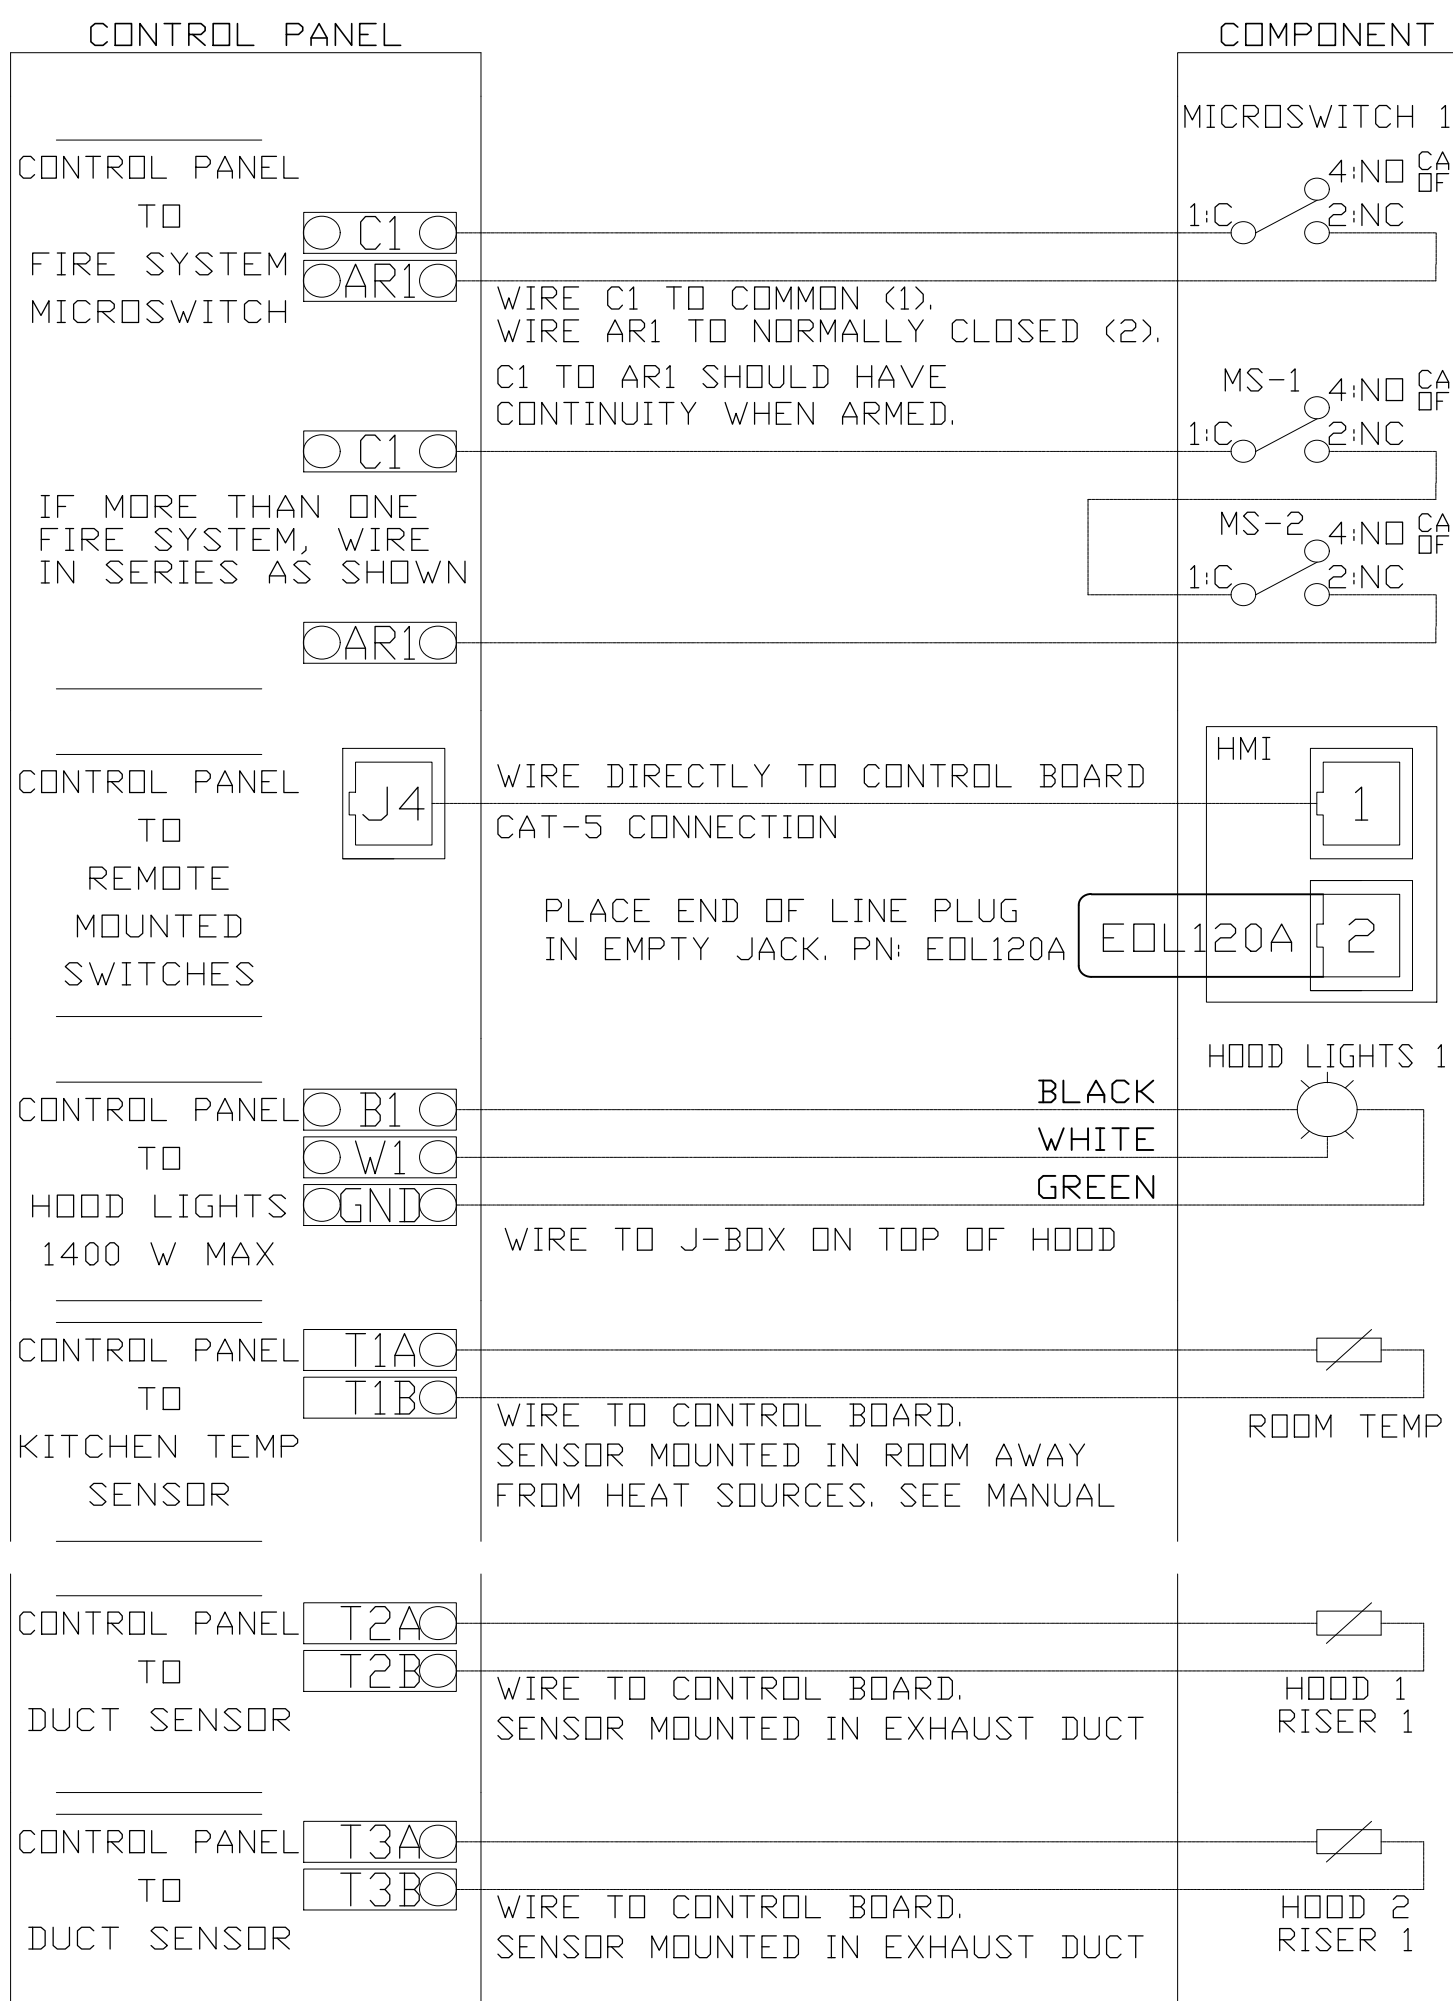



## BREAKER PANEL TO FANS

Responsibility: Electrician

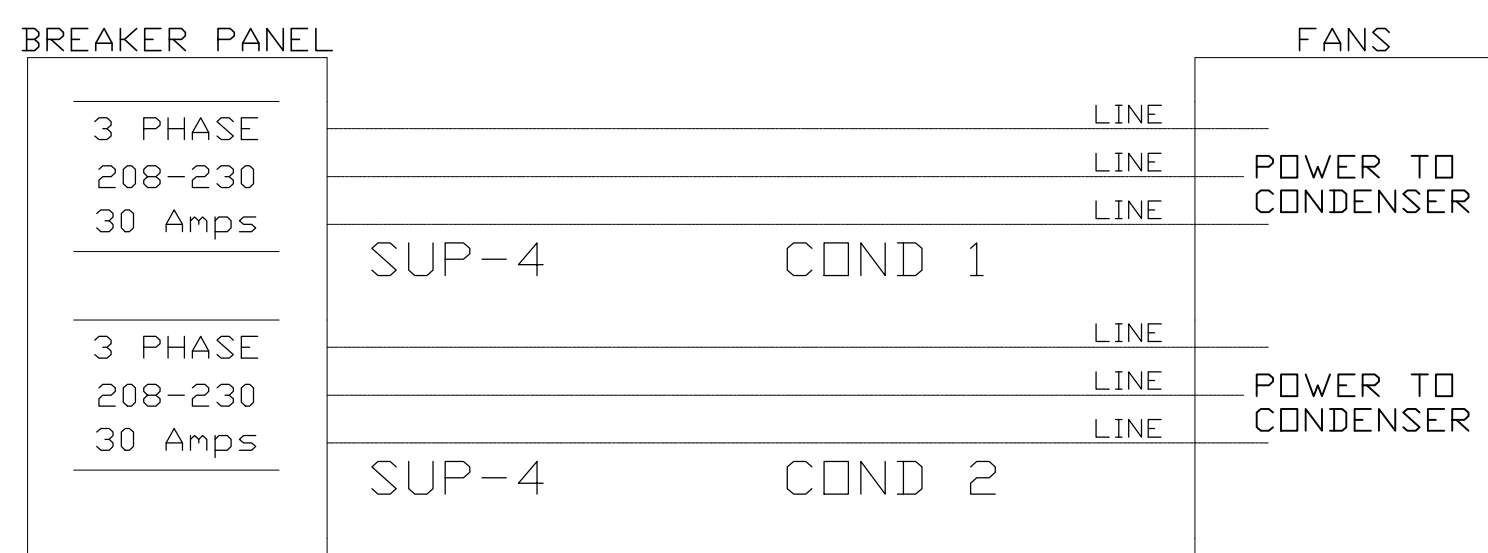

## CONTROL PANEL TO FANS

Responsibility: Electrician

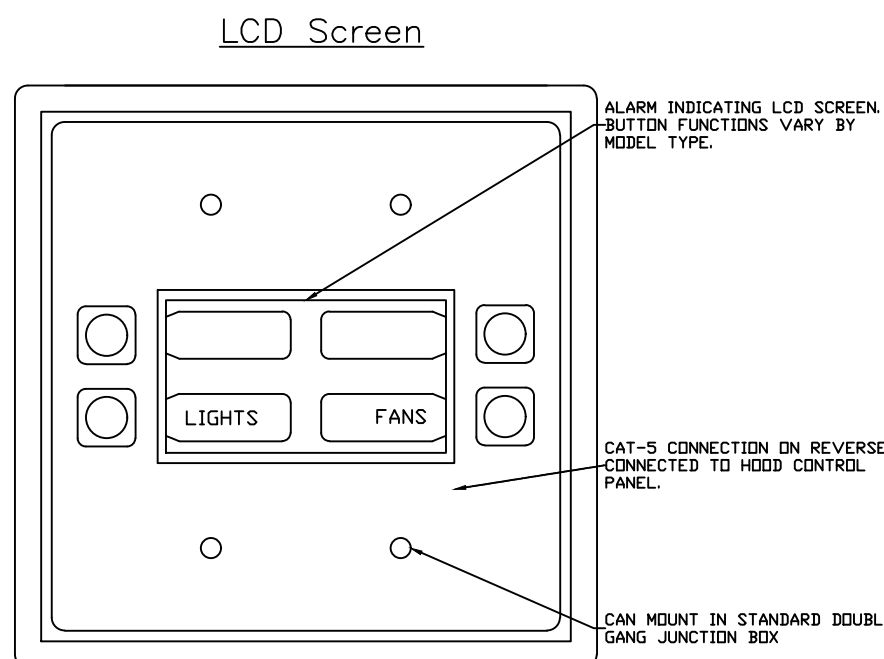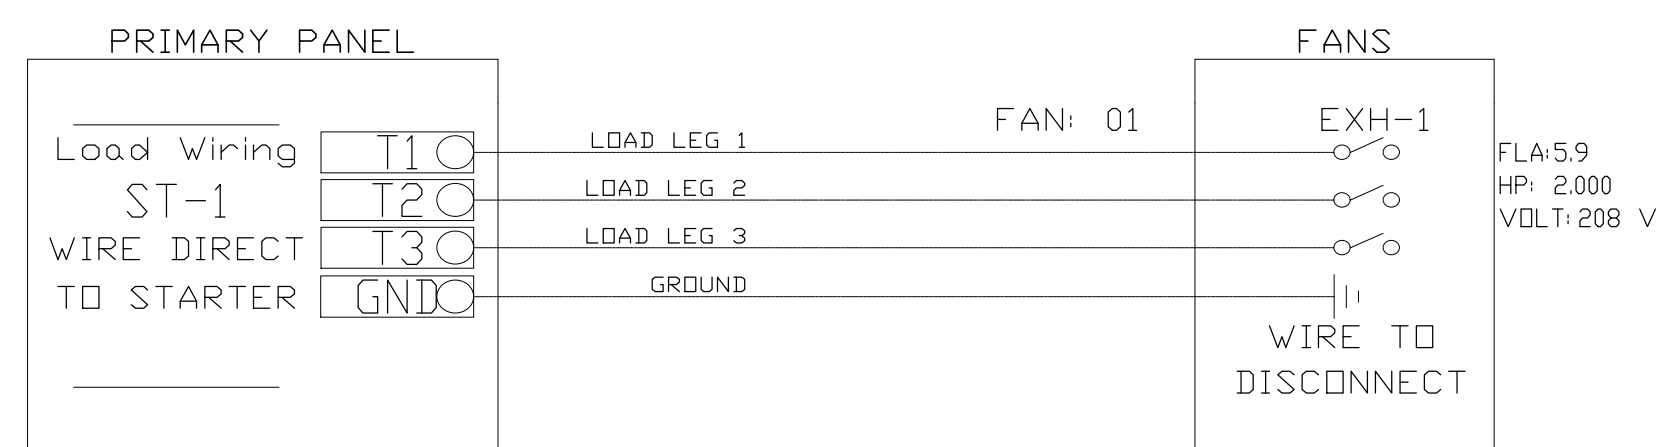

NOTE: UNLESS OTHERWISE STATED, PANDA RESTAURANT GROUP SHALL PROVIDE ALL EQUIPMENT ON THE FOLLOWING CAPTIVEAIRE SHEETS, INCLUDING: HOODS, FIRE SYTEM, EXHAUST FANS, SUPPLY FAN, BATHROOM FAN AND ELECTRICAL INTERLOCK PACKAGE

## ANSUL GAS VALVE:

THE ANSUL GAS VALVE IS PROVIDED BY CAPTIVEAIRE SYSTEMS. CONTACT OUR OFFICE WITH THE VALVE SIZE 3 DAYS IN ADVANCE OF WHEN IT IS NEEDED ON SITE.

FOR QUESTIONS CALL THE CAPTIVEAIRE SOUTHERN CALIFORNIA OFFICE  
STONE HILL DESIGN CENTER  
2915 RED HILL AVE, SUITE C106  
COSTA MESA, CA 92626  
TEL: 800-967-7701 EMAIL: REG86@CAPTIVEAIRE.COM

## REVISIONS

DESCRIPTION	DATE



www.captiveaire.com

reg86@captiveaire.com

Southern California Office

3002 Dow Ave., Suite 410, Tustin, CA 92780 PHONE: (714) 957-1500 FAX: (919) 227-5975 EMAIL: reg86@captiveaire.com

Panda Express - Rome GA (58-20-D7281)

ROME, GA, 30161

DATE: 8/5/2019

DWG.#:  
3931358

DRAWN BY: AHJ-86

SCALE:  
3/4" = 1'-0"

MASTER DRAWING

SHEET NO.  
5

PANDA RESTAURANT GROUP INC.  
1683 Walnut Grove Ave.  
Rosemead, California  
91770

Telephone: 626.799.9898  
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

## REVISIONS:

## ISSUE DATE:

1 09.20.19 ISSUE FOR PERMIT  
2 01.29.2020 ISSUE FOR BID

DRAWN BY: WRM

PANDA PROJECT #: - 58-20-D7281

C&amp;P PROJECT #: - 2190345



1925 Prospect Ave. Orlando, FL 32814  
P (407) 661-9100  
F (407) 661-9101  
www.c.p.ca  
Florida Certified Public Accountant

01.29.2020

## PANDA EXPRESS

TRUE WARM AND WELCOME 2300  
TURNER MCCALL BLVD & HICKS DR  
ROME, GA 30161

M-404

HOOD DETAIL PLAN

TRUE WARM &amp; WELCOME 2300 R1