

\_\_\_\_\_

CONTRACT DATE:	4.3.17
BUILDING TYPE:	EXPLORER LG-54
PLAN VERSION:	NOVEMBER 2015
SITE NUMBER:	XXXXXX
STORE NUMBER:	XXXXX

TACO BELL  
LAKEPOINT  
EMERSON, GA 30137




**TACCO  
BELL**

**EXPLORER**


**ELECTRICAL  
DETAILS**

**E7.0**

PLOT DATE: 08/17/17E

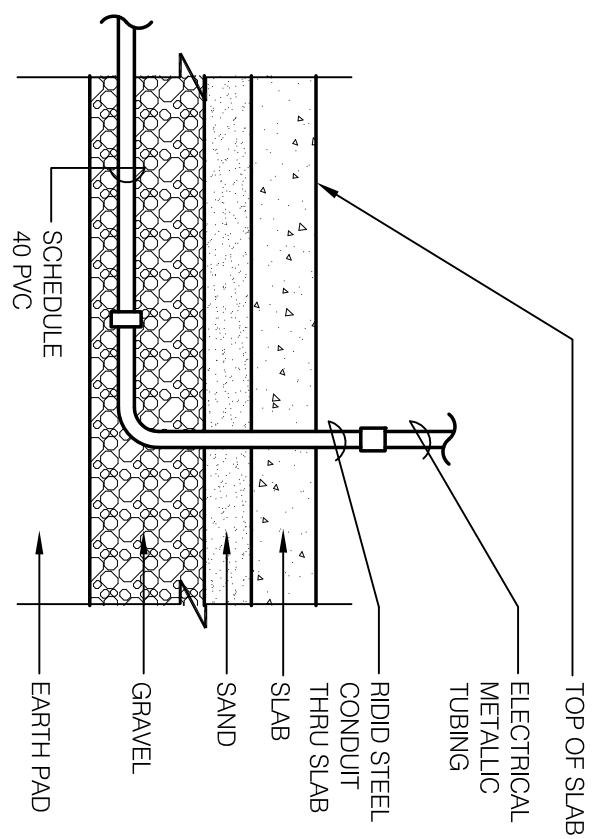

REQUIRED IN ALL CONDUITS, SIZED PER N.E.C. REQUIREMENTS.	YES001
<b>UNDER SLAB CONDUIT</b>	N.T.S.
<b>17</b>	<b>17</b>

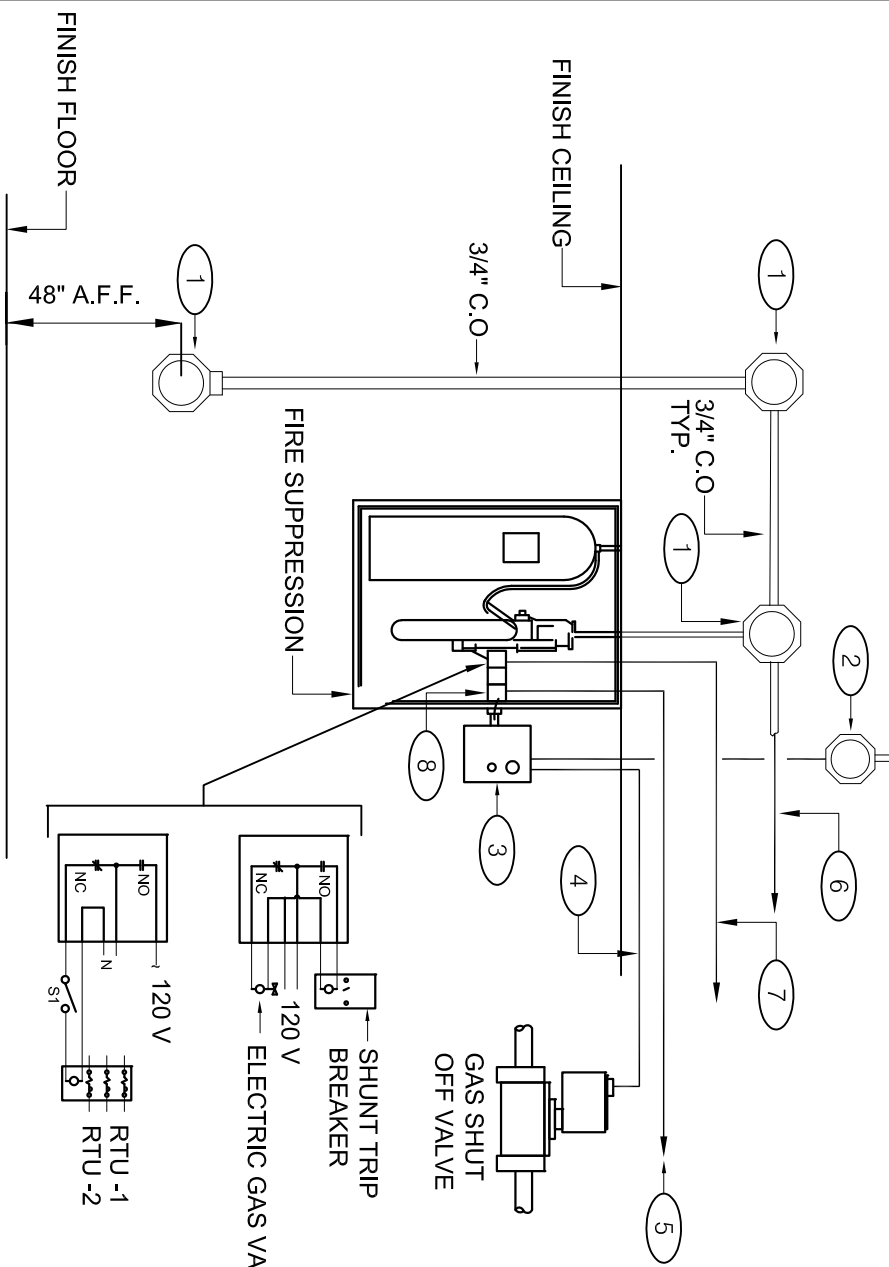

<b>FIRE SUPPRESSION SYSTEM WIRING DIAGRAM</b>	N.T.S.	<b>9</b>
---	--------	----------


**GENERAL NOTES:**

1. REFER TO SHEET M3.0

### KEY NOTES:

- 2. PROBE, JBOX, AND 110 CIRCUIT. REFER TO EQUIPMENT SCHEDULE FOR PLAN OR CIRCUIT ASSIGNMENT. INTERCONNECT TO MANUAL RESET RELAY THROUGH MICROSWITCH.
- 3. MANUAL RESET RELAY FINISHED WITH UNIT INSTALLED BY E.C.
- 4. PROVIDE 1/2" C WITH CONTROL CABLE. MAKE INTERCONNECTIONS TO VALVE AND RESET RELAY.
- 5. PROVIDE 1/2" C WITH CONTROL CABLE. MAKE INTERCONNECTIONS TO EXHAUST & SUPPLY FAN INTERFACE THROUGH MICROSWITCH ON HOOD.
- 6. CABLE AND CONNECTION TO FUSIBLE LINKS AT EXHAUST HOOD BY E.C.
- 7. PROVIDE INTERCONNECTION TO SHUNT TRIP BREAKER AT PANEL AND MICROSWITCH ON HOOD.
- 8. SLOT FOR SNAP ACTION IN MICRO-SWITCH. UP TO FOUR SWITCHES AVAILABLE FOR LOCK-UP.  
SWITCH 1: GAS SHUT-OFF VALVE.  
SWITCH 2: EXHS.  
SWITCH 3: SHUNT TRIP BREAKER IN ELE PANEL.


<b>NOT USED</b>	N.T.S.	<b>10</b>
-----------------	--------	-----------

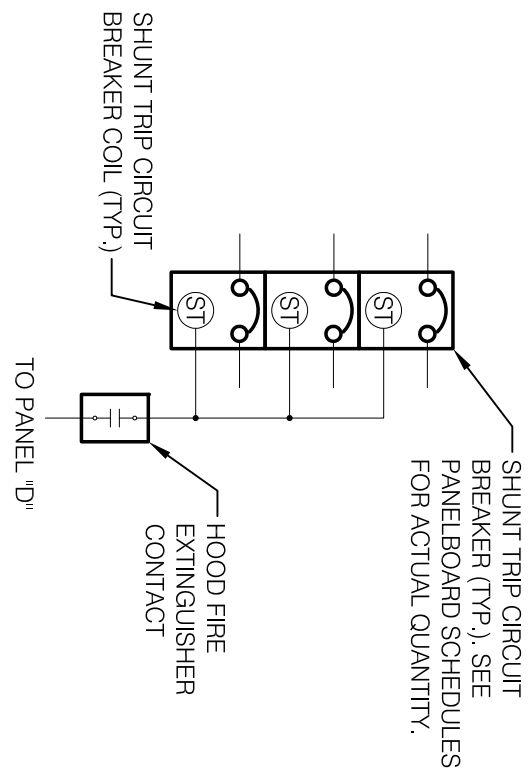


SEQUENCE OF OPERATION:

UPON ACTION OF ANY HOOD FIRE SUPPRESSION SYSTEM RELAY, A RELAY IN THAT FIRE SUPPRESSION SYSTEM SHALL CAUSE ALL SHUNT TRIP CIRCUIT BREAKERS TO OPERATE, THUS REMOVING POWER FROM ALL DEVICES CONNECTED TO EQUIPMENT LOCATED UNDER THE GREASE HOOD. EXHAUST FANS SHALL NOT BE AFFECTED BY THIS ACTION AND SHALL CONTINUE TO BE CONTROLLED AS INDICATED IN THE SEQUENCE OF OPERATIONS INDICATED IN DETAIL 216/0.

SHUNT TRIP DETAIL	N.T.S.	11
-------------------	--------	----

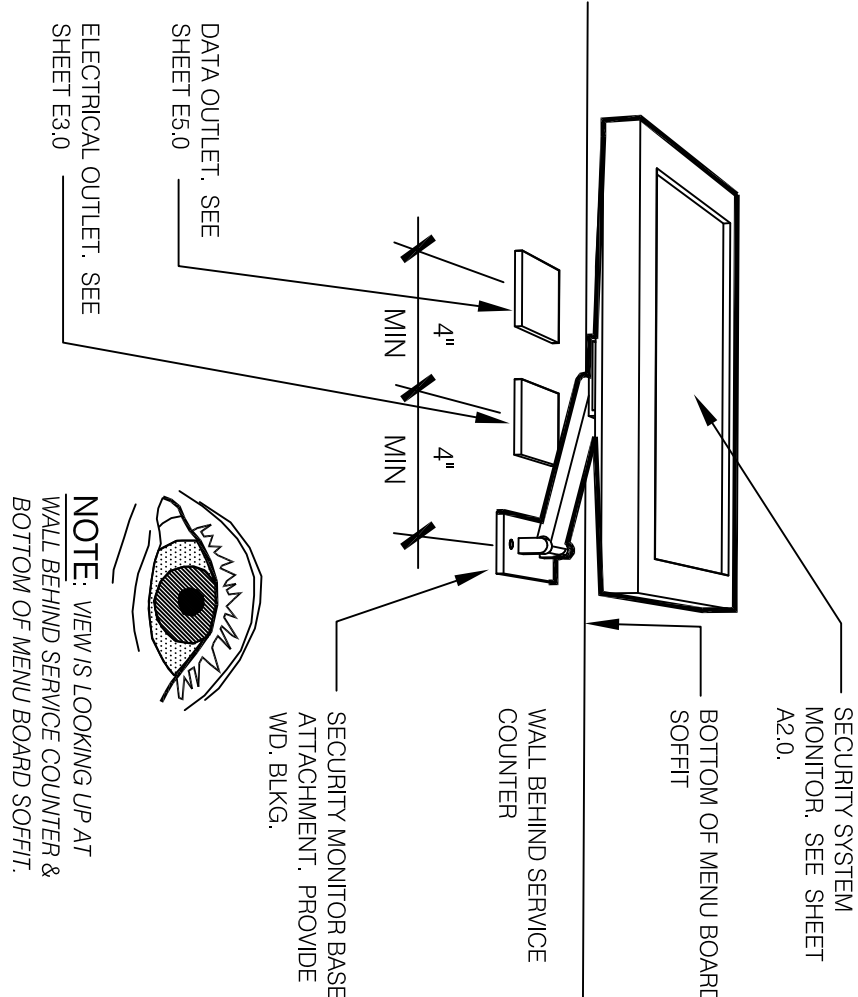


POWER/DATA @ SECURITY MONITOR	N.T.S.
	<b>12</b>

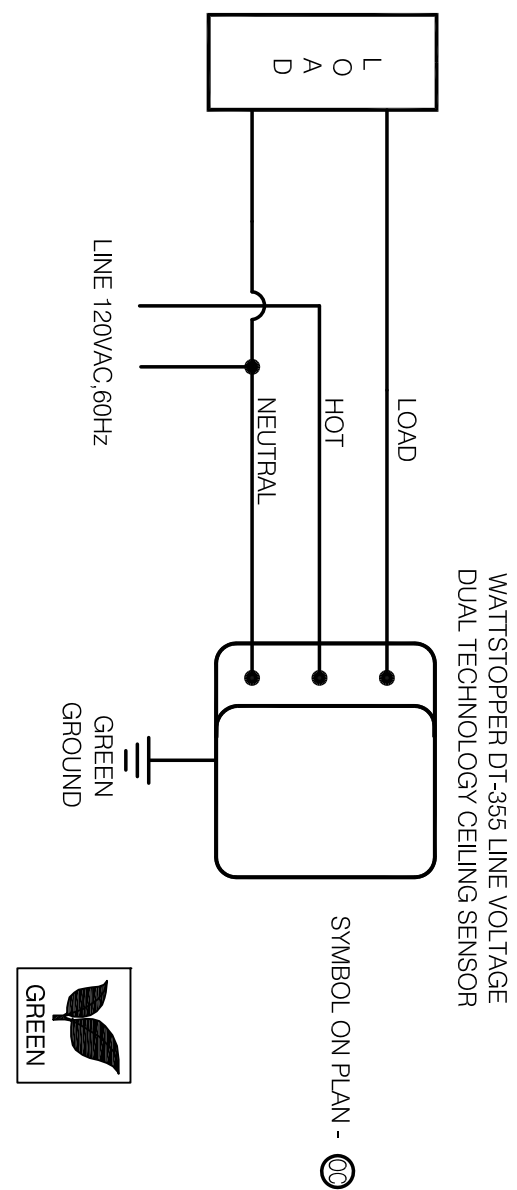

<b>NOT USED</b>	N.T.S.	<b>1</b>
-----------------	--------	----------

<b>CEILING OCCUPANCY SENSOR WIRING DIAGRAM</b>	N.T.S.	<b>2</b>
--	--------	----------

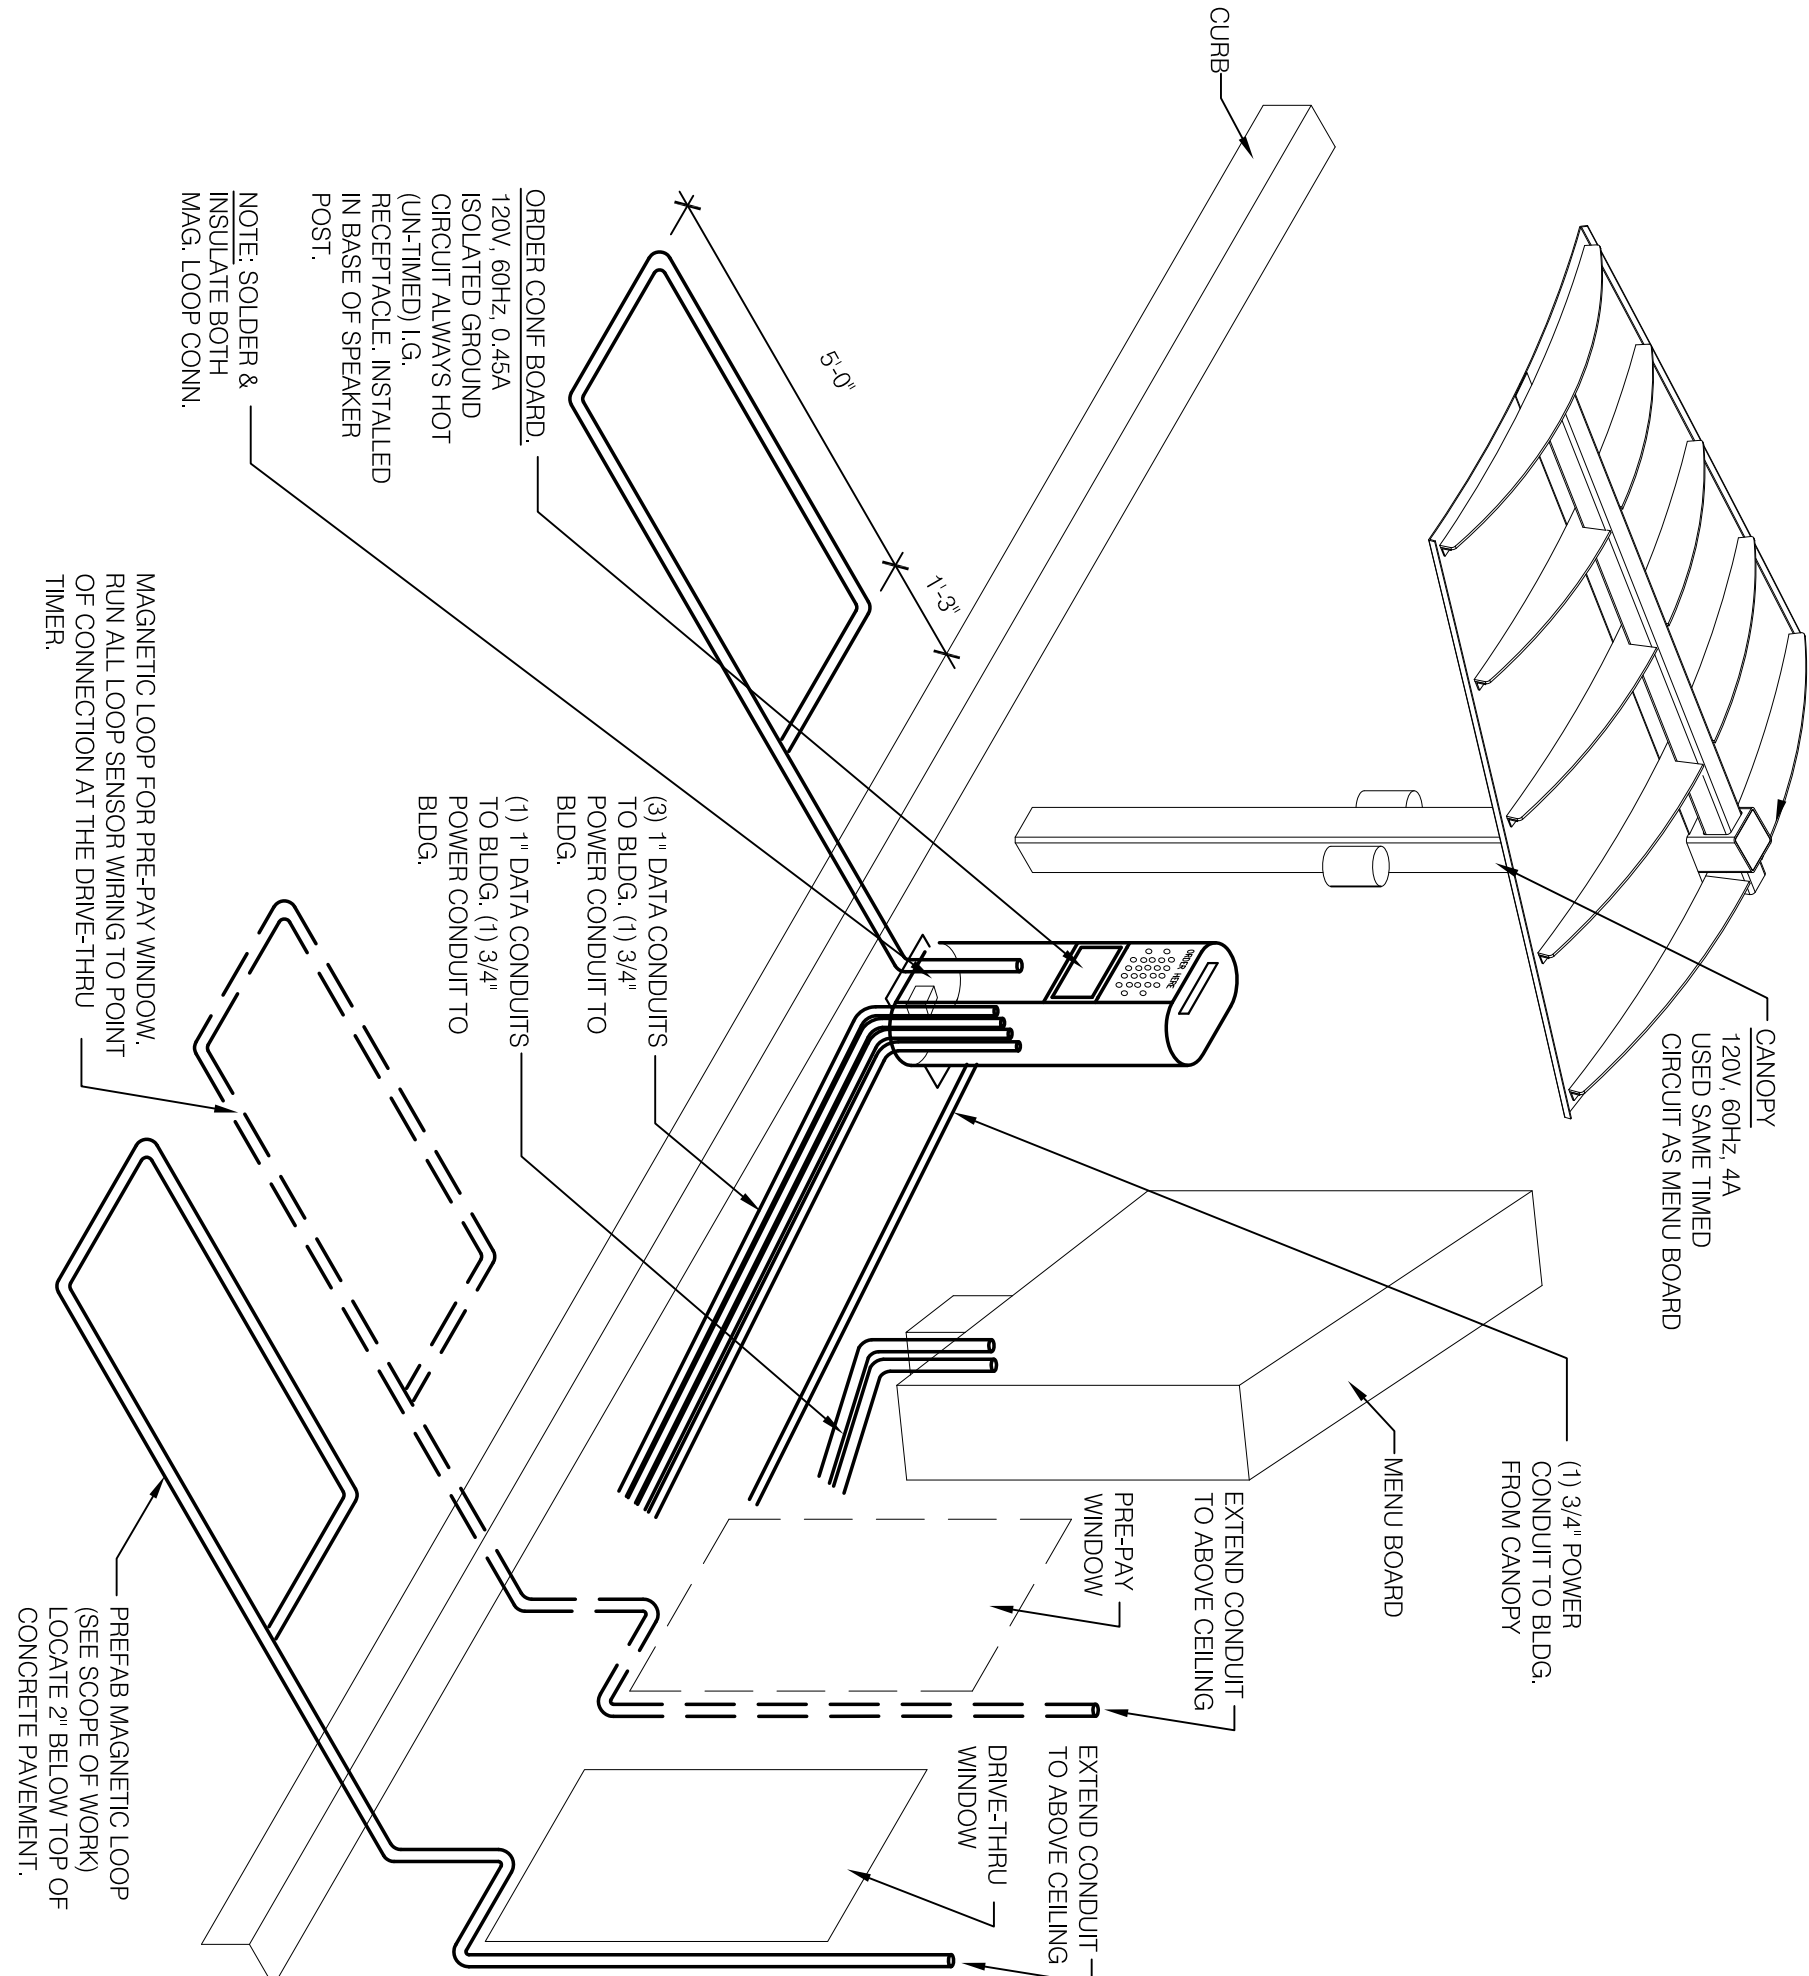

<b>DRIVE-THRU COMMUNICATIONS ISOMETRIC</b>	N.T.S.	<b>4</b>
--	--------	----------