




WATER RISER DIAGRAM 5
NO SCALE P-400

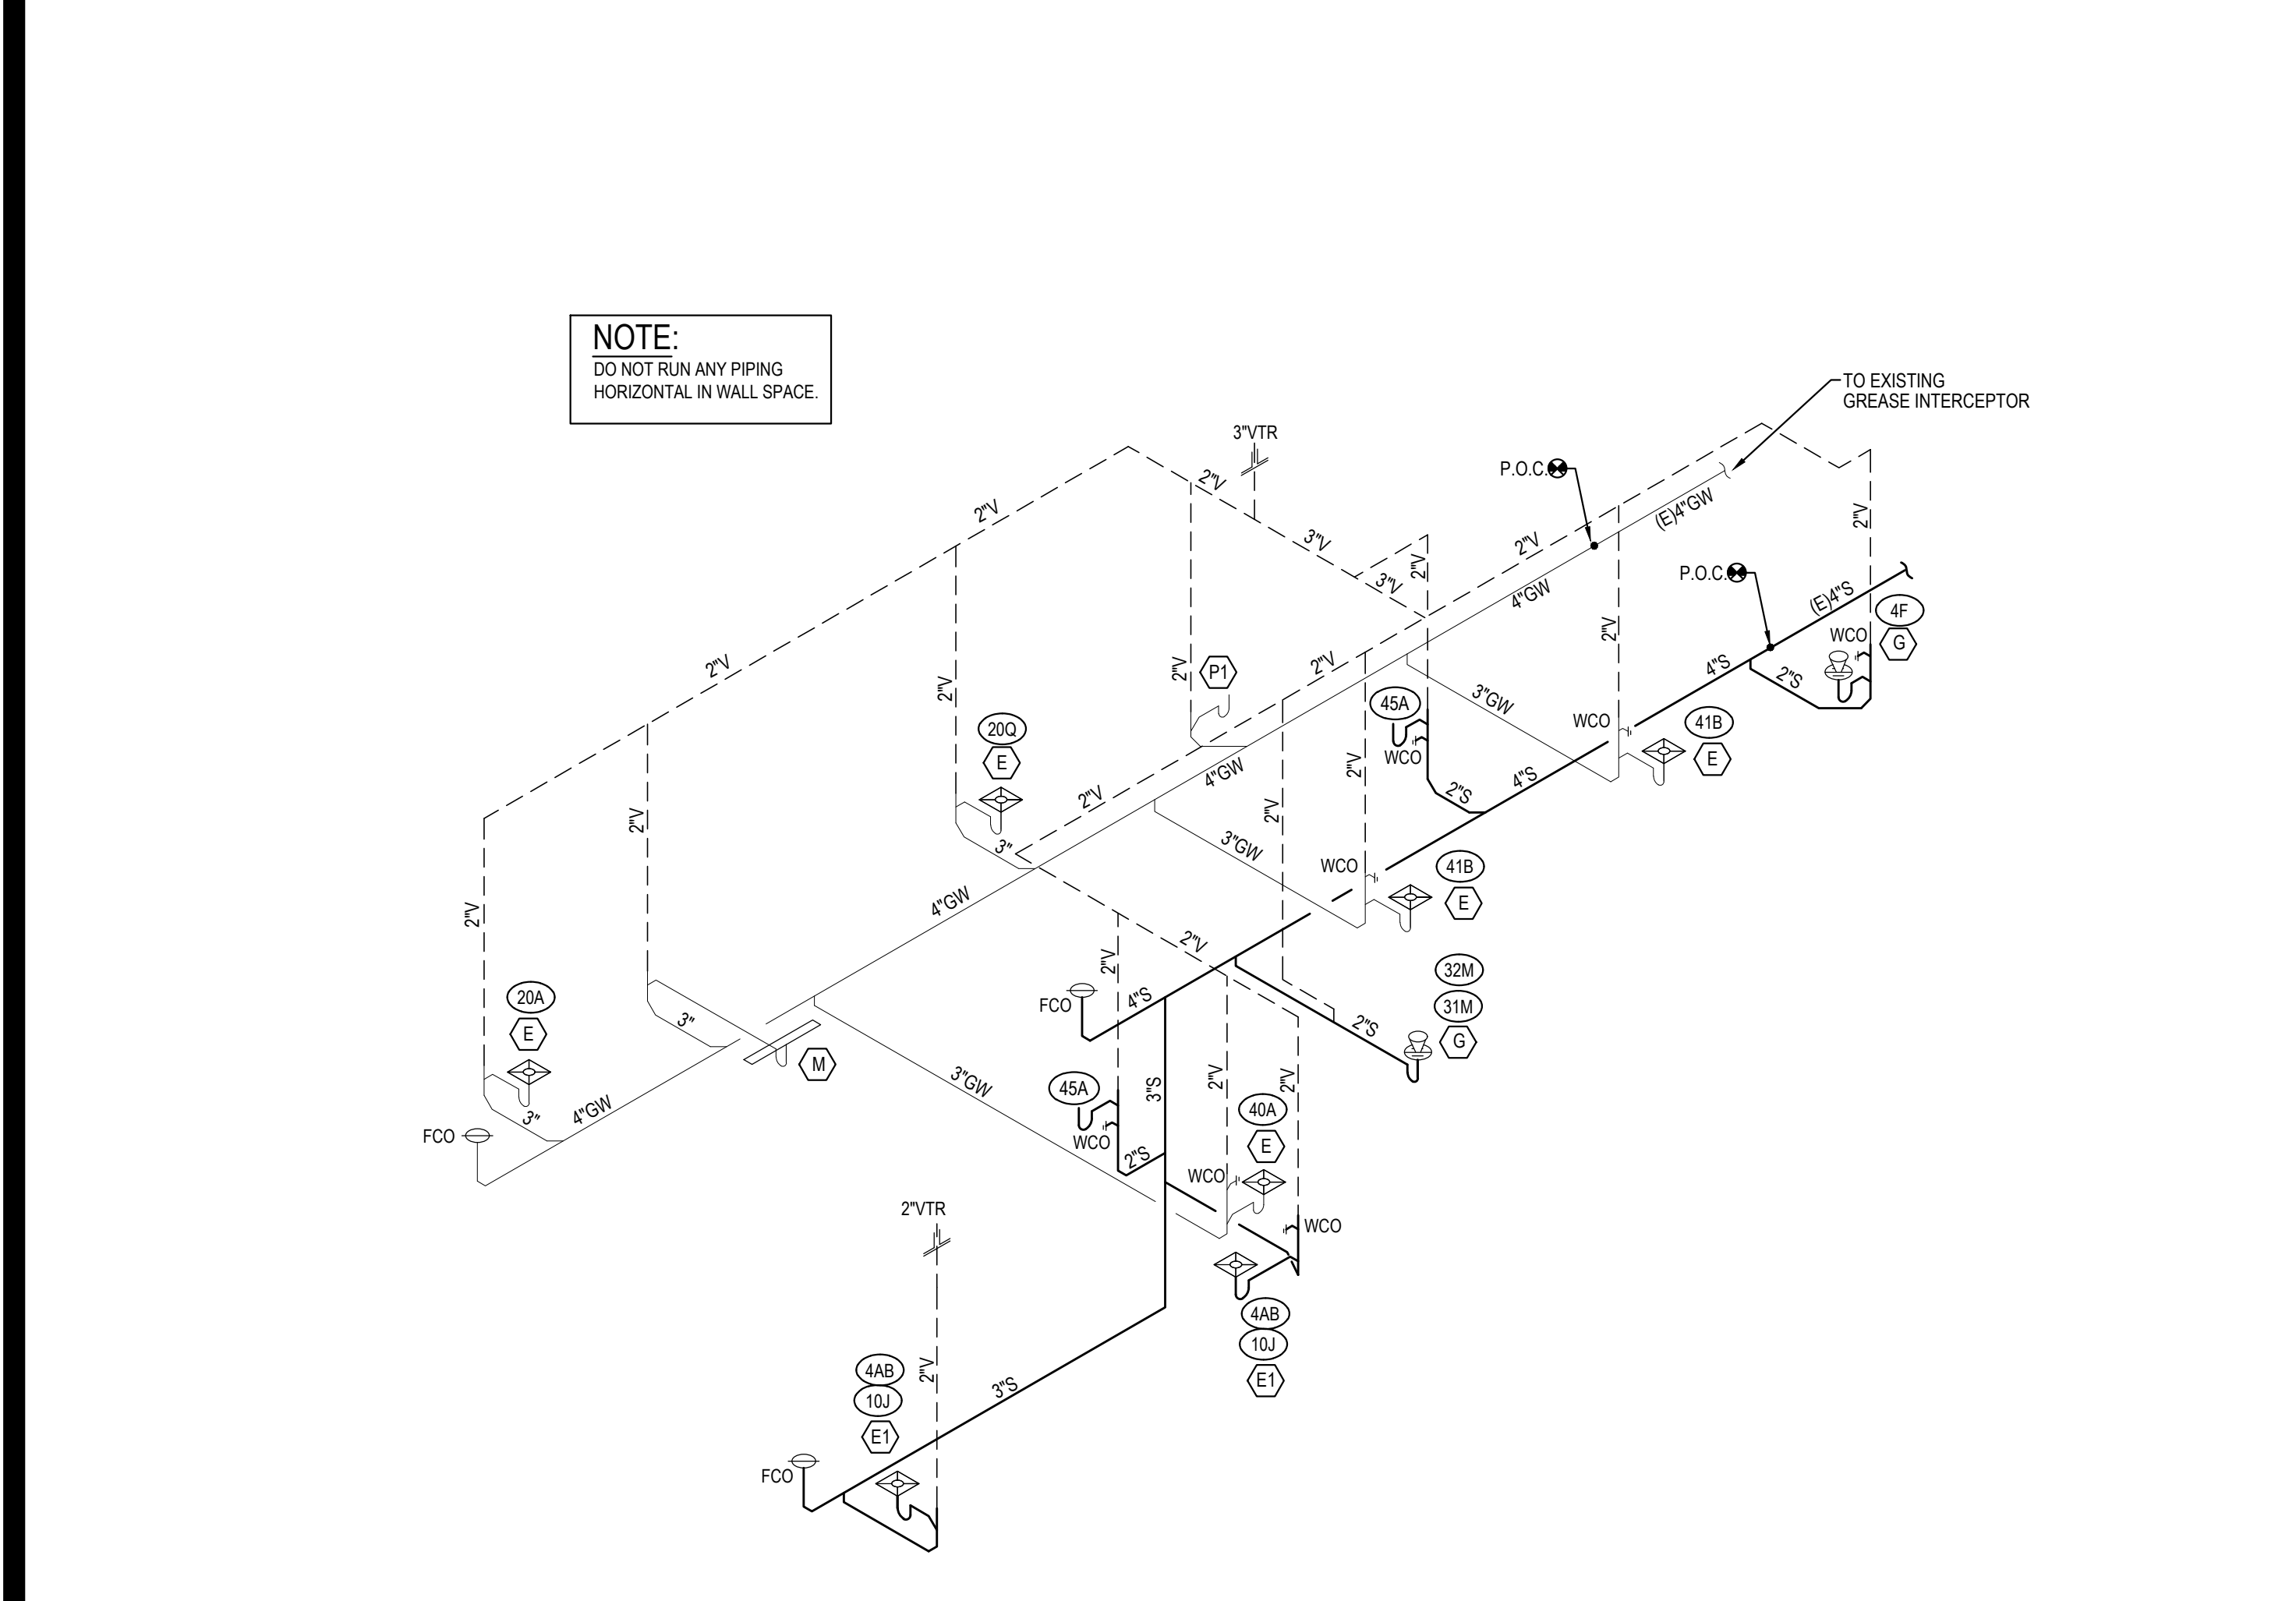


WASTE AND VENT RISER DIAGRAM 4
NO SCALE P-400

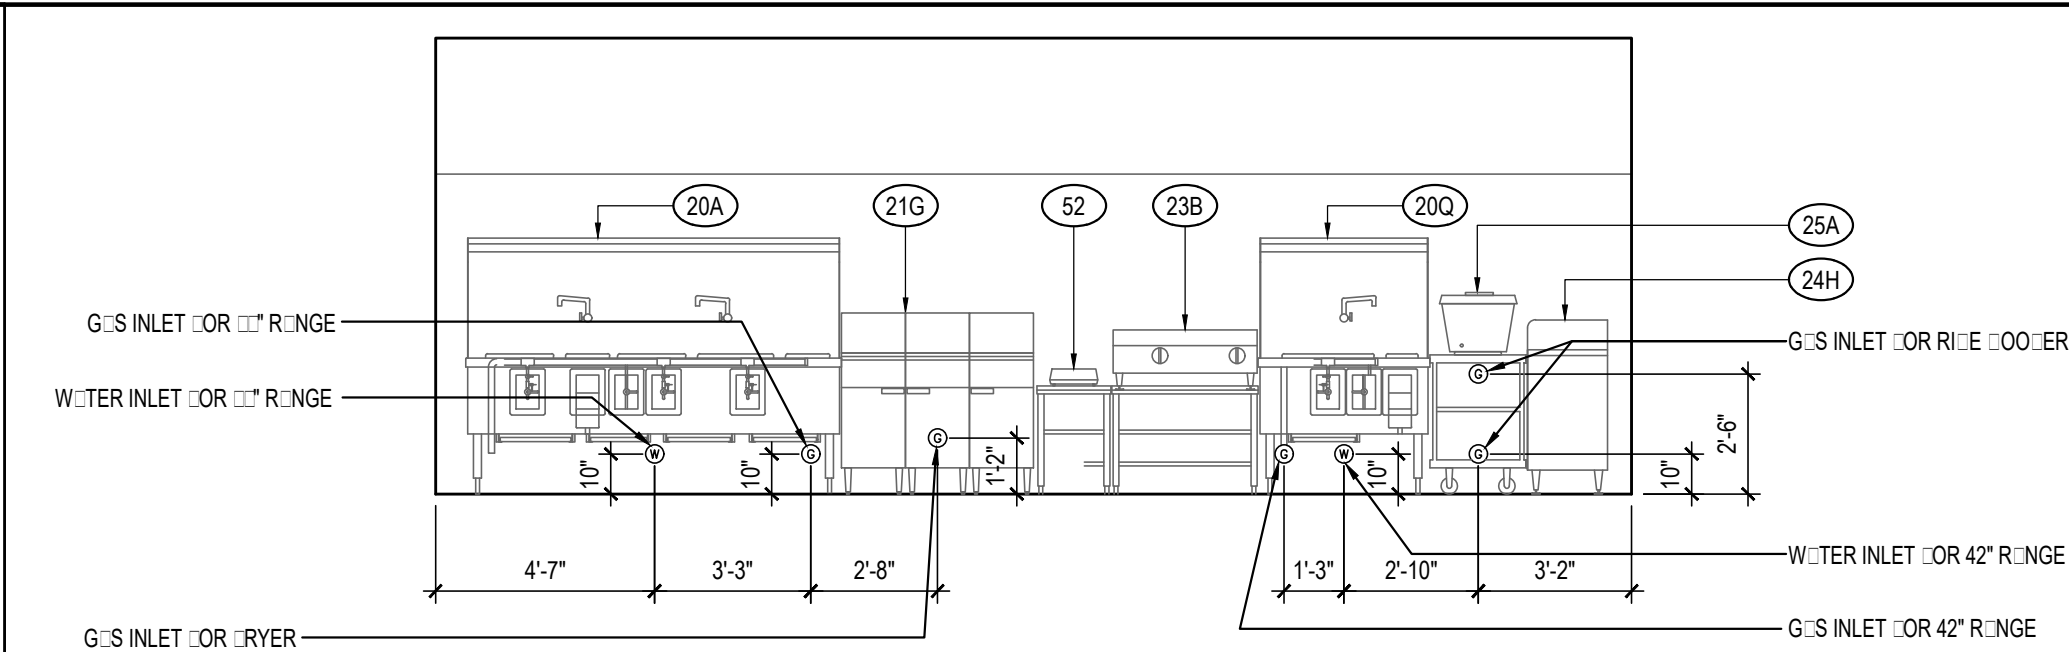

GAS COOKLINE ELEVATION 4
NO SCALE P-400

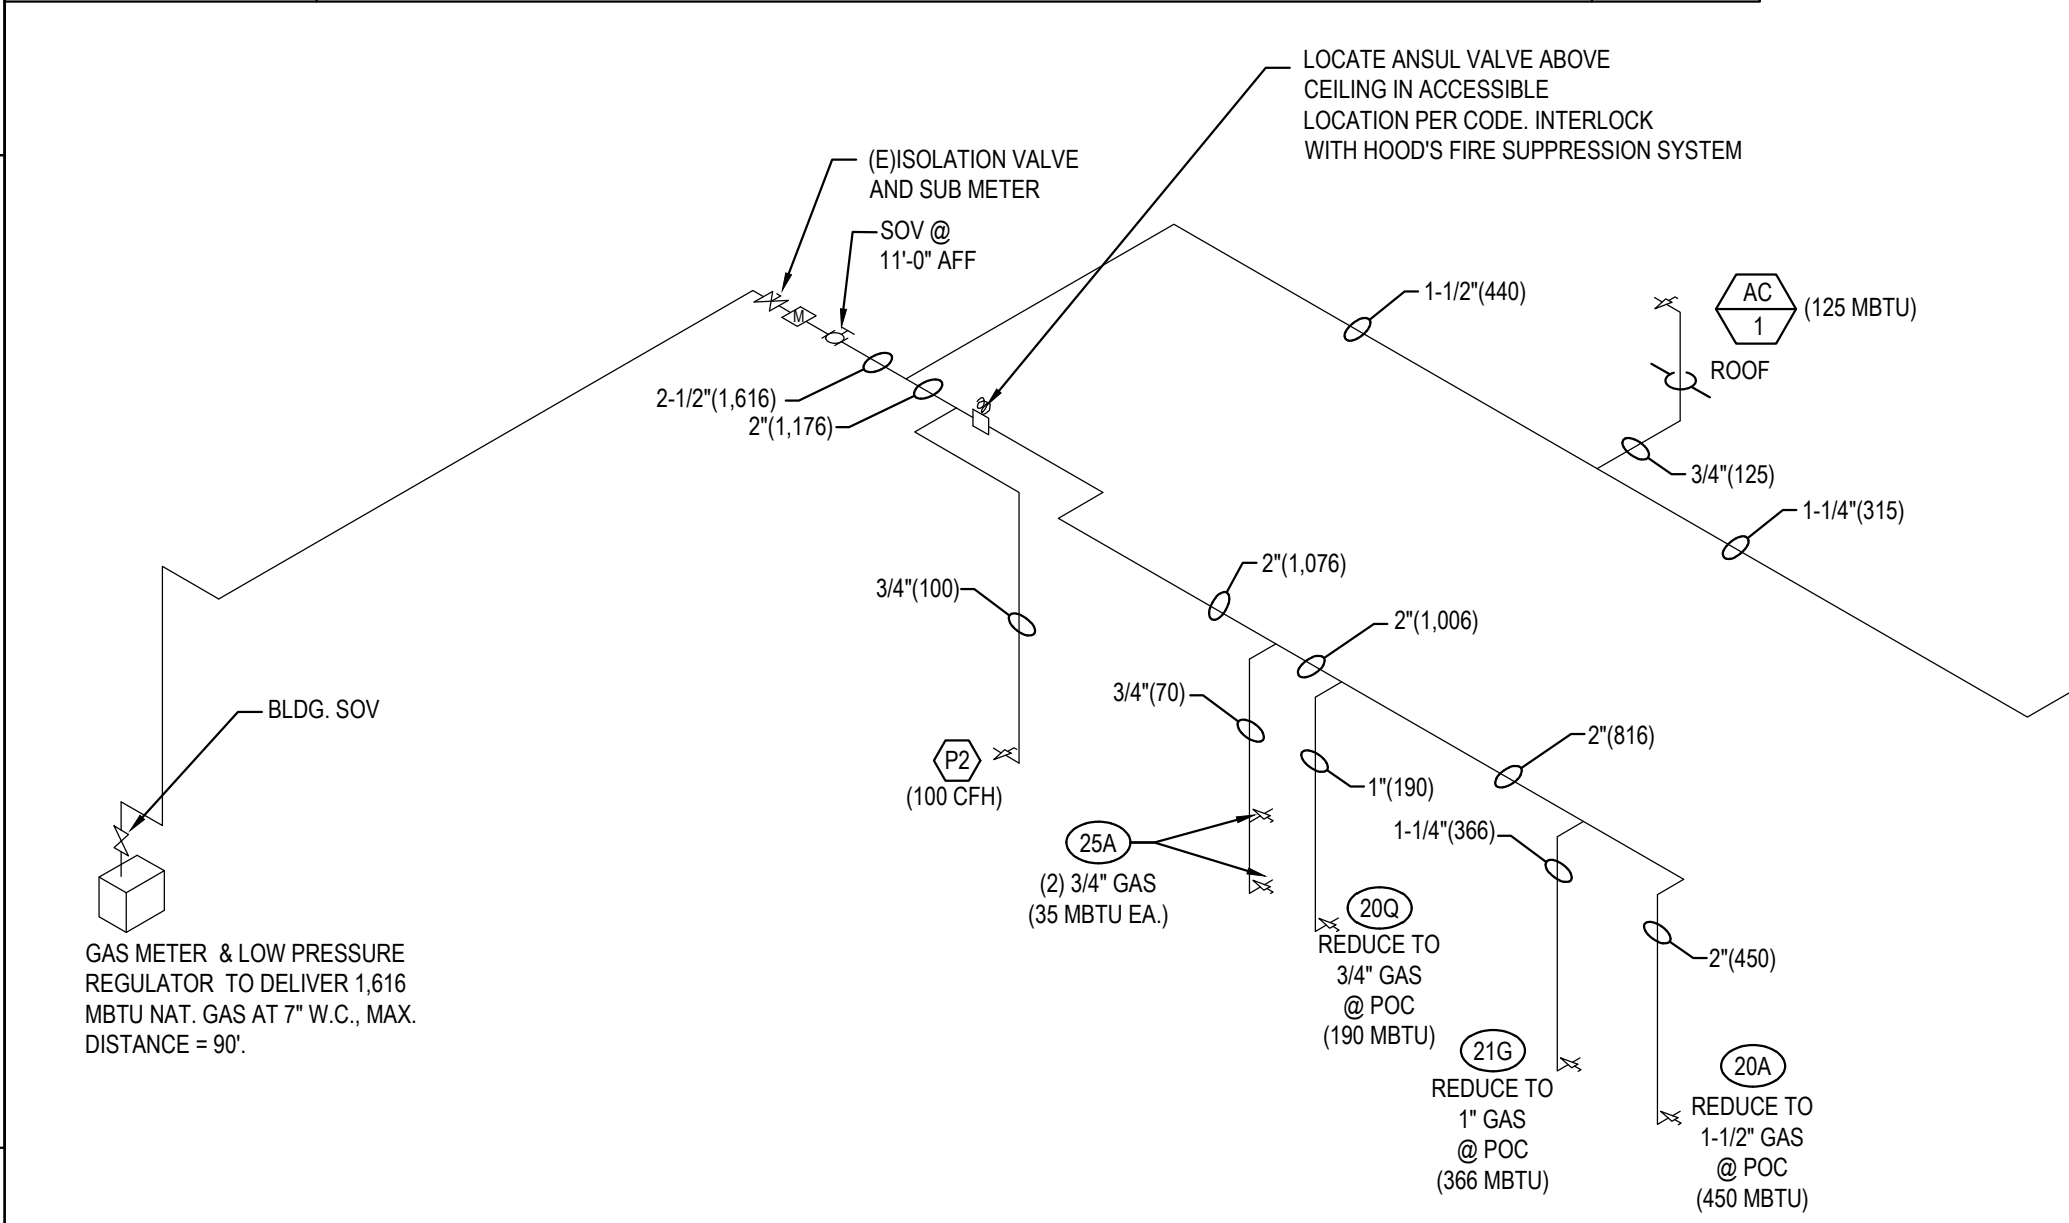

GAS RISER DIAGRAM 3
NO SCALE P-400

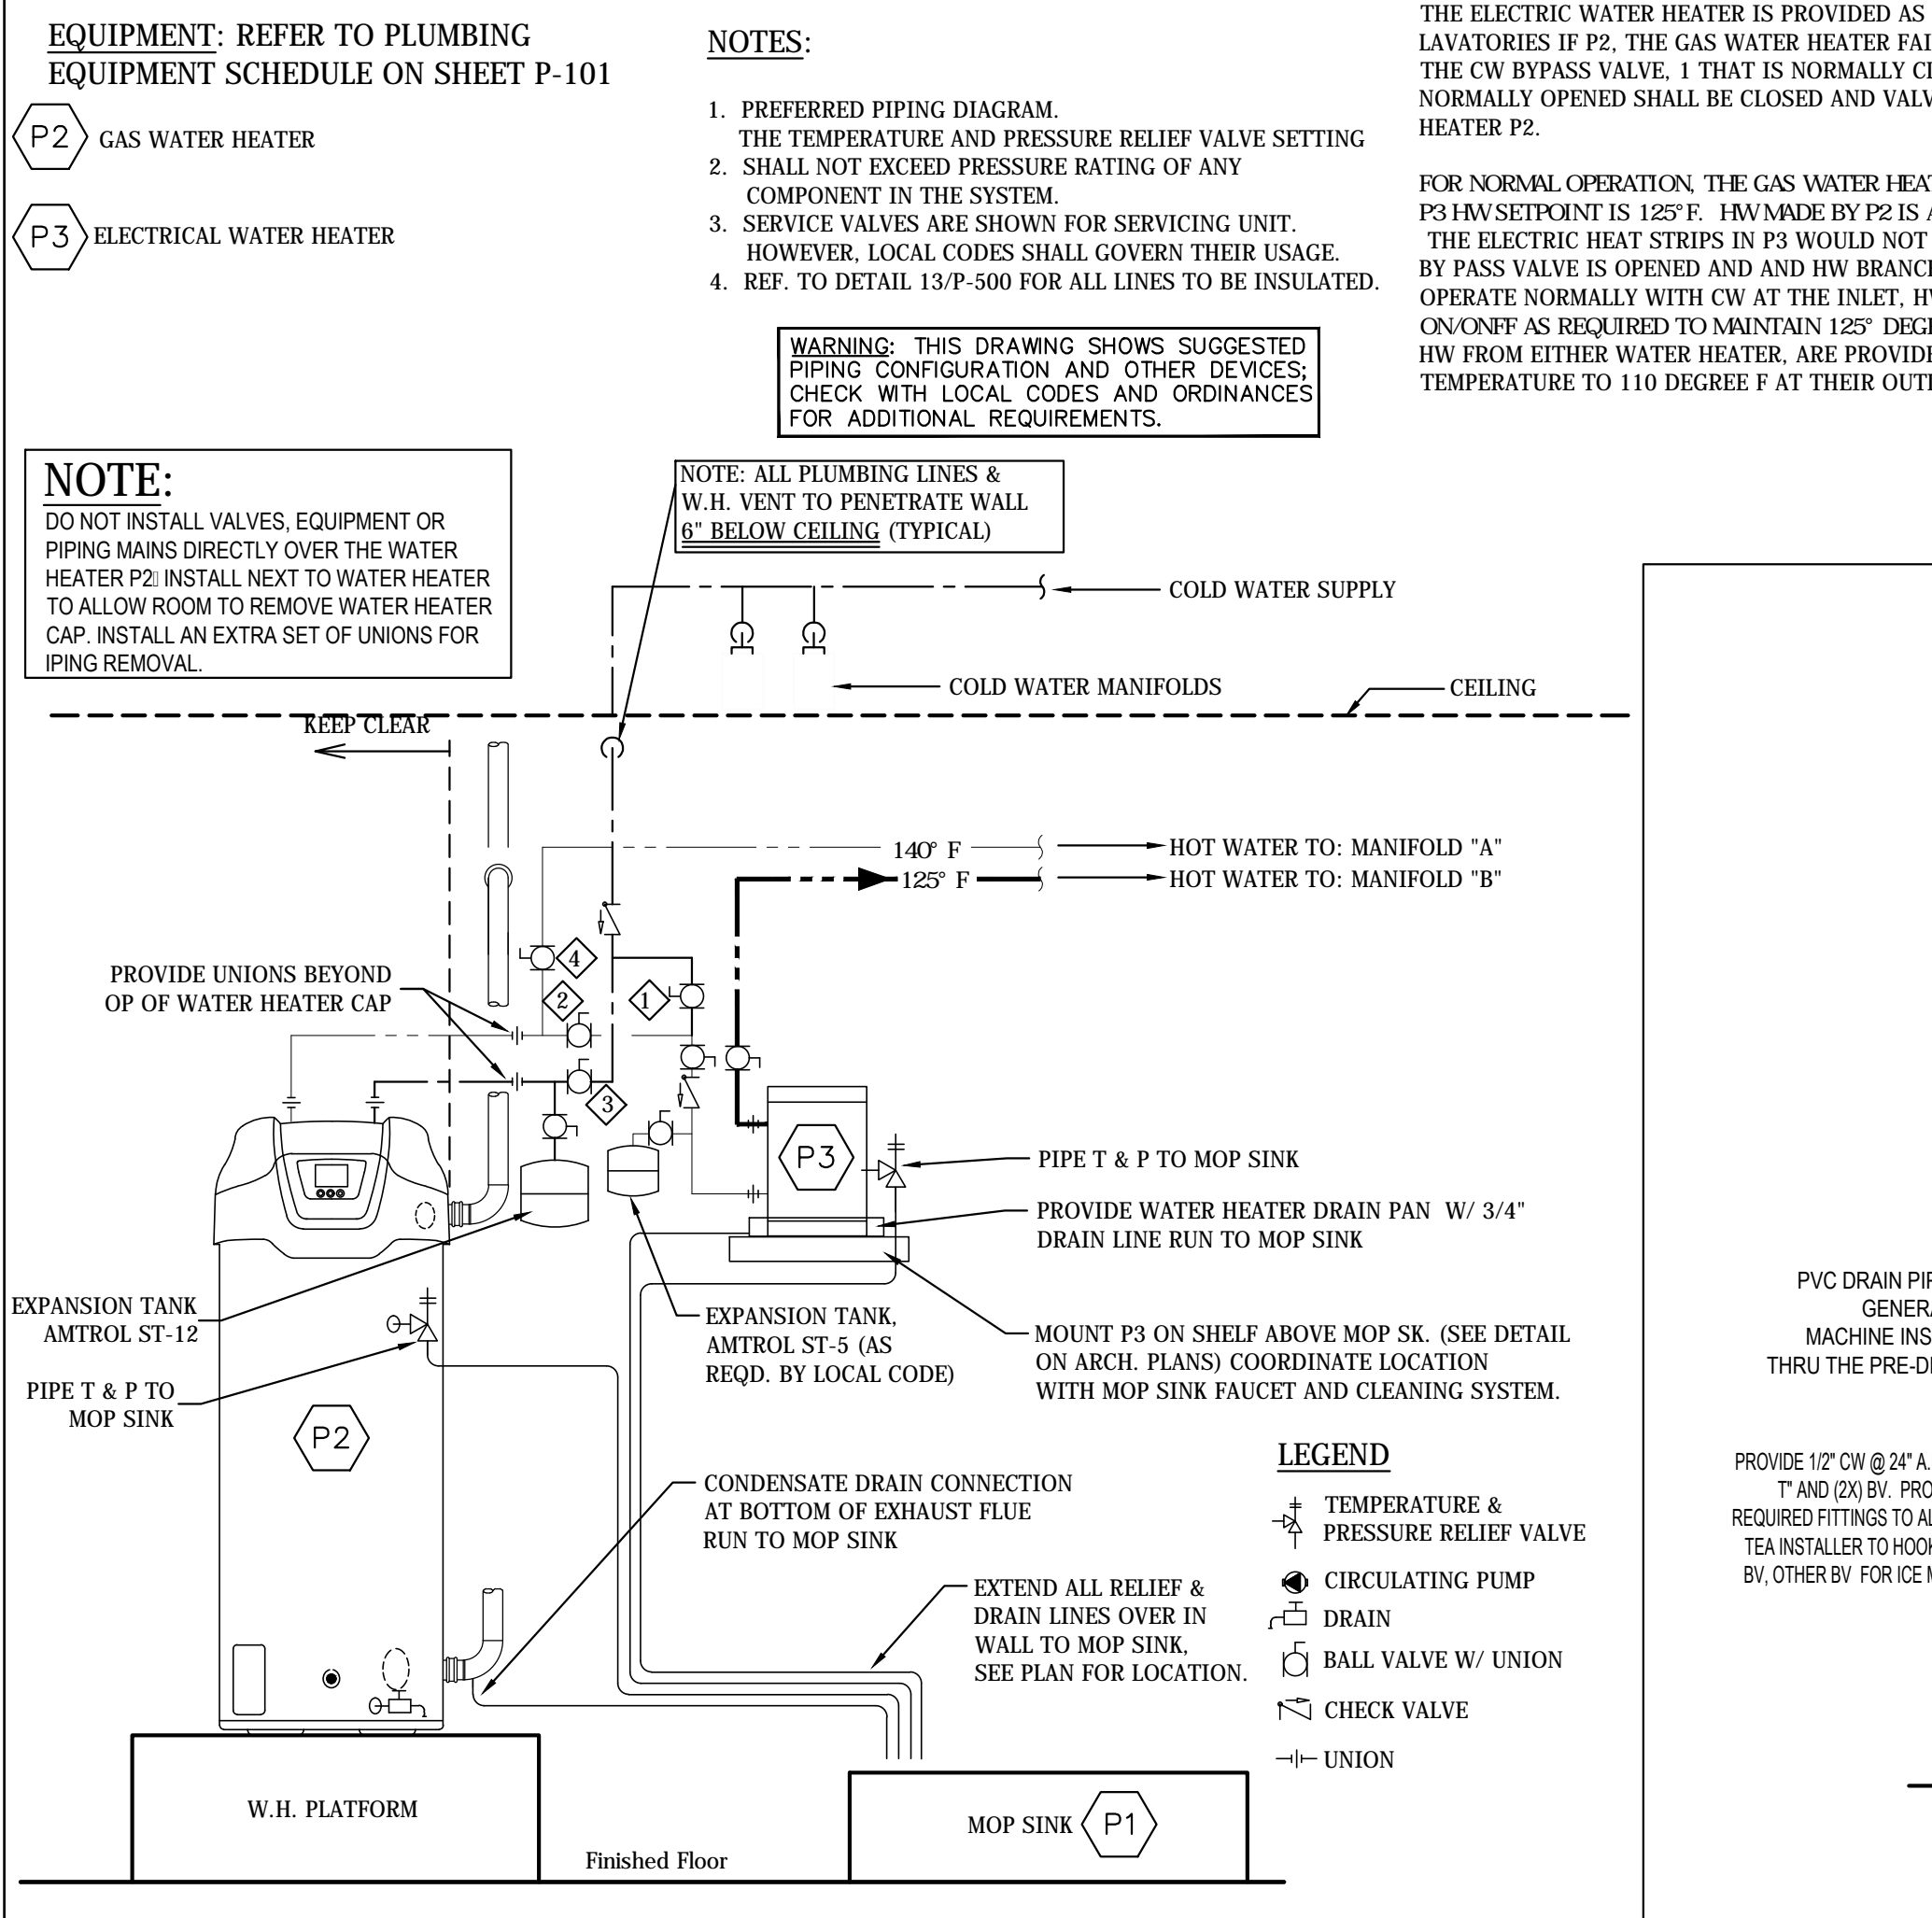

HOT WATER SYSTEM DIAGRAM 2
NO SCALE P-400


GAS EQUIPMENT SCHEDULE				
ITEM	QTY	EQUIPMENT	MBTU	
			EACH	TOTAL
P2	1	WATER HEATER	100	100
20A	1	CHINESE RANGE	450	450
20C	1	CHINESE RANGE	190	190
21G	1	DEEP FRYER	366	366
25A	2	RICE COOKER	35	35
AC-1	1	AIR CONDITIONER	125	125
MA-1	1	MAKE-UP AIR UNIT	315	315
TOTAL				1,616

LOCALIZATION:


TOTAL DEVELOPED LENGTH: 90'

TOTAL LOAD: 1,616 MBTU


NOTE: DO NOT RUN ANY PIPING HORIZONTAL IN WALL SPACE.

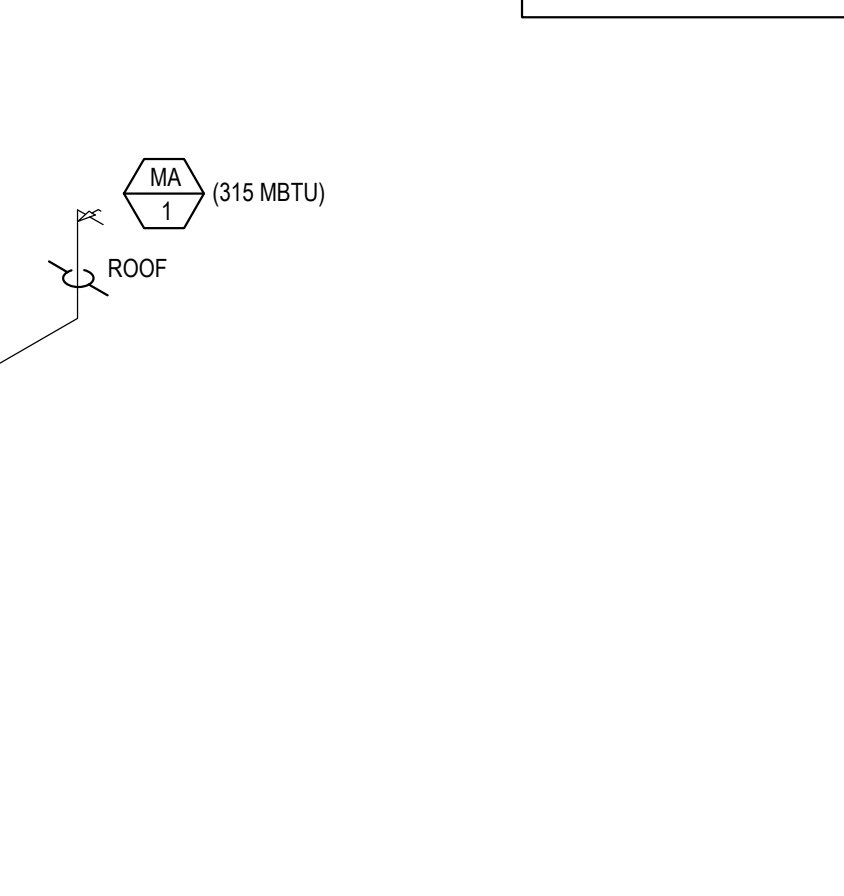

GAS RISER DIAGRAM 3
NO SCALE P-400

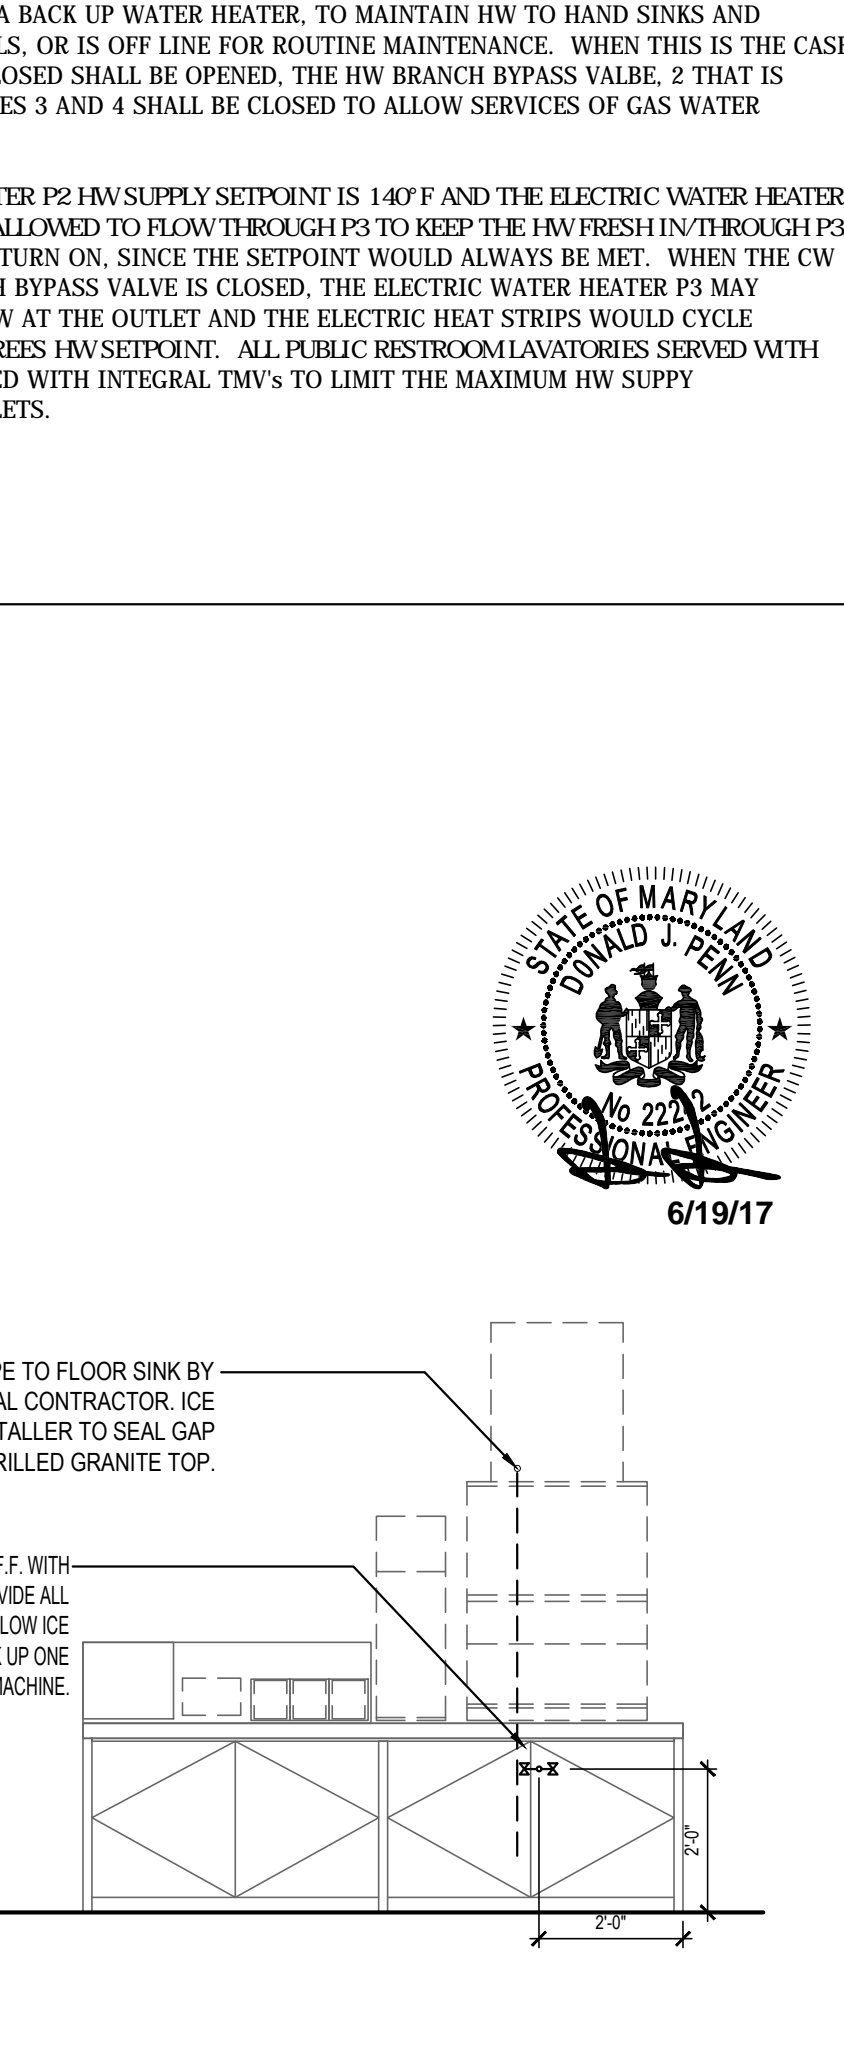

DRINK STATION PLUMBING 1
NO SCALE P-400



PANDA RESTAURANT GROUP INC.
1683 Walnut Grove Ave.
Rosemead, California 91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated, or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

1	100% SUBMITTAL
---	----------------

ISSUE DATE:

1	100% SUBMITTAL
---	----------------

CHECKED BY: STAFF

DRAWN BY: STAFF

PANDA PROJECT #: B1-17-D5167

ARCH PROJECT #:

don penn consulting engineer

1301 SOLANA BLVD., BLDG. 1,
SUITE 1420
WESTLAKE, TEXAS 76262
Phone: 817-410-2858
Fax: 817-251-8411

Professional Certification

I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland. License number 22242, Expiration Date: 02/03/19

PANDA EXPRESS

NAS PAX RIVER
PAX RIVER NAVY BASE
PATUXENT RIVER, MD

P-400

WATER & GAS WASTE
CENT RISER DIAGRAMS

CONSTRUCTION SET - 2017/07/30